


| | | |
|--------|--------------|---------|
| SHT.NO | NO. OF SHTS. | DRG NO. |
| | | |

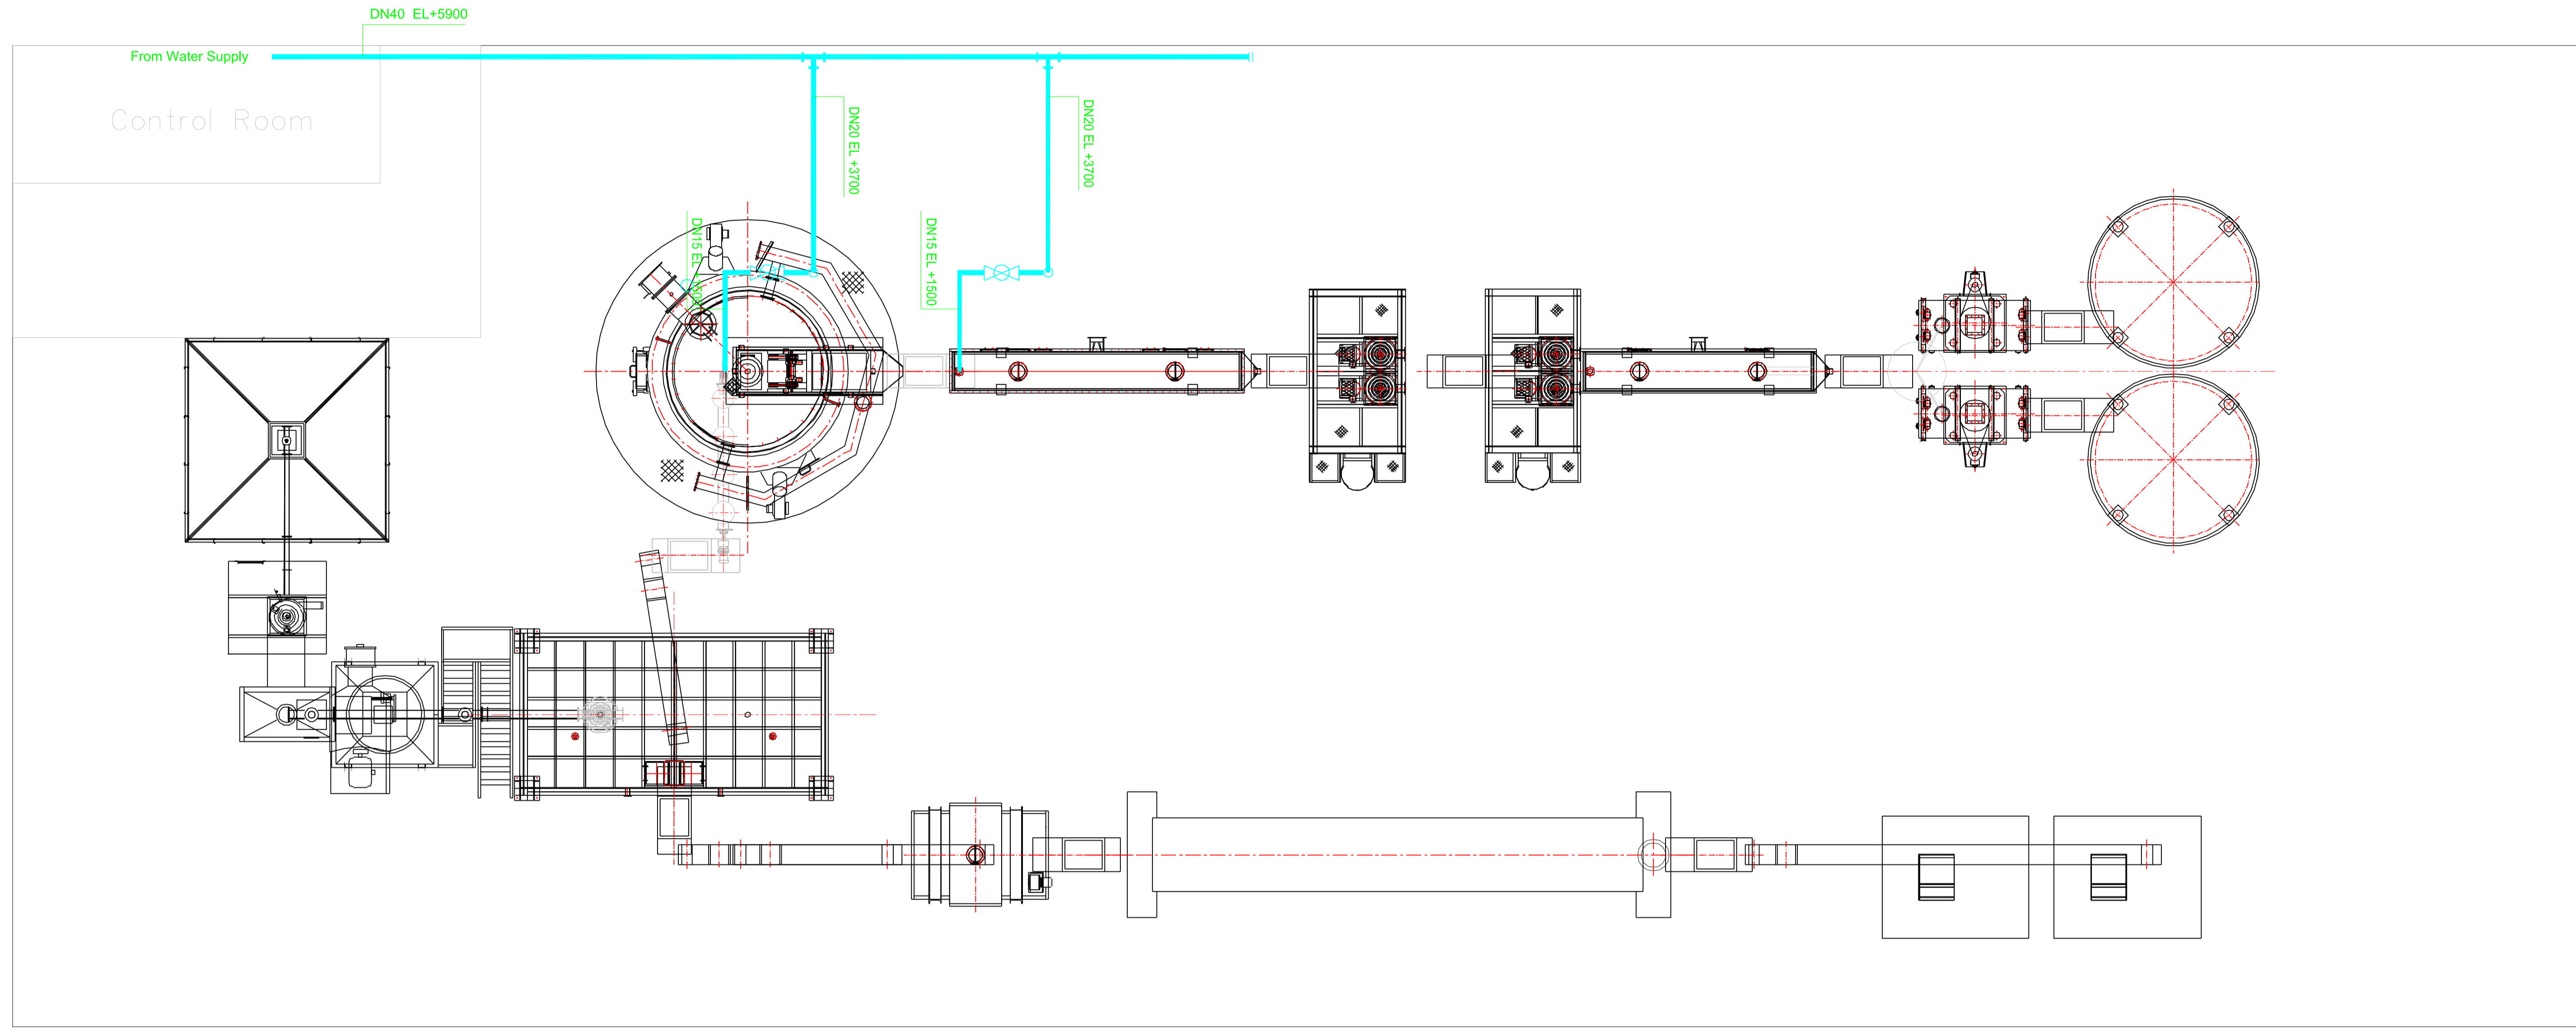

- Note:**
1. The piping setting must according to the regulations in India.
 2. The pipe diameter is based on the water pressure.
 3. Install the control valves as required.
 4. Install the safety device as required.

- ?????
1. ??????????????????
 2. ??????????????????
 3. ??????????????????
 4. ??????????????????

| | | | | | | | | | |
|---|--------|-------------|--|---|--------|--|--|--|--|
| THIS DRAWING IS THE PROPERTY OF ASIA CHEMICAL TECHNOLOGY AND MUST NOT BE DISTRIBUTED OR REPRODUCED WITHOUT PERMISSION | | | | | | | | | |
| REVISION DESCRIPTION | DATE | NAME | ACLINK ASIA CHEMICAL TECHNOLOGY Room 717 Hualian Developing Plaza Xinhua Road No.728 Shanghai,200052 P.R.China TEL: (+86) 21 62941889 FAX: (+86) 21 62941882 | | | | | | |
| | DRAWN | 02.Jan.2014 | Y.G. | | | | | | |
| | DESIGN | | | | | | | | |
| APPROVED | | | | | | | | | |
| DATE | SCALE | 1:80 | REV. | B | TITLE | Gokul SR Plant (Kalhapur) Water Piping | | | |
| | | | | | DRG NO | KFC02-100-303B | | | |